

TEST REPORT

No. : SZIN2311002595PL05_EN

Date : 2023-12-08

Page: 1 of 12

Scan to see the report



Verification:
check sgschina.com.cn

CUSTOMER NAME: BEIJING NEW BUILDING MATERIALS PUBLIC LIMITED COMPANY
ADDRESS: TOWER A,BNBM CENTER,FUTURE SCIENCE PARK,NO.9,QIBEI ROAD,CHANGPING DIST,BEIJING,PEOPLE'S REPUBLIC OF CHINA

Sample Name : GNG Standard Gypsum Board

Product Specification : 2440×1220×12

Manufacturer : Beijing New Building Materials Public Limited Company

Above information and sample(s) was/were submitted and confirmed by the client. SGS, however, assumes no responsibility to verify the accuracy, adequacy and completeness of the sample information provided by client.

SGS Ref. No. : SDFS2311007617FF

Date of Receipt : 2023-11-28

Testing Period : 2023-11-28 to 2023-12-08

Test result(s) : For further details, please refer to the following page(s)

(Unless otherwise stated the results shown in this test report refer only to the sample(s) tested)

This assessment/test report is not valid unless endorsed by China Union Building Materials Ltd.

Signed for
SGS-CSTC Standards Technical
Services Co., Ltd. ShenZhen Branch.

Jessie Ho
Authorized signatory



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing/inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC Standards Technical Services Co., Ltd.
Shenzhen Branch

Room 101-301, Plant 4 & Floor 101, Plant 2 & Floor 101, Plant 3 & Floor 301-501 Plant 3, Jiahehuo (Bantao) Industrial Plant Area, No. 430, Jias Road, Bantao Community, Bantao Street, Luogang District, Shenzhen, Guangdong, China 518128 www.sgschina.com.cn
中国·广东·深圳市龙岗区坂田街道雪岗社区吉华路430号江源(坂田)工业区厂区4号101-501, 2号101, 3号101, 3号301-501 邮编: 518128 (86-755) 25328673 sgs.china@sgs.com

TEST REPORT

No. : SZIN2311002595PL05_EN

Date : 2023-12-08

Page: 2 of 12

Test Result Summary

No.	Test(s) Requested	Result(s)	Comments
1	BS 476 Part 6:1989+A1:2009+C1:2014 Fire tests on building materials and structures Part 6 Method of test for fire propagation for products.	Refer to next page(s)	The tested sample complies with the requirement of Class 0 of UK Building Regulations 2010
2	BS 476 Part 7:1997+CORR:2014 Fire tests on building materials and structures Part 7. Method of test to determine the classification of the surface spread of flame of products (Class 1)	Class 1	Approved Document B(2006 edition), Volume 1- Dwellinghouse, appendix A paragraph 13.
3	BS 476 4:1970+CORR:2014 Fire tests on building materials and structures-Part 4: Non-combustibility test for materials.	Non-combustible	/

This assessment/test report is not valid unless endorsed by China Union Building Materials Ltd.



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing/inspection report & certificate, please contact us at telephone: (+86-755) 8307 1443, or email: CN.00check@sgs.com

SGS (Shenzhen) Technical Services Co., Ltd.
Shenzhen Branch

Room 101-301, Plant 4&8 Floor 101, Plant 2&6 Floor 111, Plant 3&8 Floor 301-501 Plant 1, Jianghu (Bantian) Industrial Plant Area, No. 430, Jhuo Road, Bantian Community, Bantian Street, Luogang District, Shenzhen, Guangdong, China 518129 www.sgs.com
中国·广东·深圳市龙岗区坂田街道坂田社区吉华路430号江湖(坂田)工业厂区厂房4号101-101, 2号101, 3号101, 3号301-501 邮编: 518129 (86-755) 25328673 sgs.china@sgs.com

TEST REPORT

No. : SZIN2311002595PL05_EN

Date : 2023-12-08

Page: 3 of 12

Test 1

I. Test conducted

This test was conducted in accordance with the procedure specified in BS 476 Part 6:1989+A1:2009+C1:2014 —Fire tests on building materials and structures— Part 6: Method of test for fire propagation for products.

II. Sample details

Sample description★	GNG Standard Gypsum Board
Thickness	12mm
Color	Grey
Specimen size	225mm×225mm

The above data and information with ★ was / were submitted and identified on behalf of the client. SGS is not responsible for the authenticity, integrity and results of the data and information and / or the validity of the conclusion. results apply to the sample as received.

This assessment/test report is not valid unless endorsed by
 China Union Building Materials Ltd.

III. Test details

Conditioning of specimens:	Prior to testing, the sample was conditioned to constant mass at a temperature of (23 ± 2) °C, and a relative humidity of (50 ± 5) %, and maintained in this condition until required for testing.
Exposed Face:	Marked surface
Form in which the specimens to be tested	Composite



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS (S) Limited, Technical Services Co., Ltd. Room 101-301, Plant 4 & Focm 11, Plant 2 & Focm 11, Plant 3 & Focm 31-501, Plant 1, Jiangnan (Bentley) Industrial Plant Area, No. 431, Jihan Road, Bantian Community, Bantian Street, Luogang District, Shenzhen, Guangdong, China 518129 www.sgs.com.cn
 Shenzhen Branch 深圳市宝安区西乡街道铁岗社区吉华路431号江澜(坂田)工业厂区厂房4号101-101, 2号101, 3号101, 3号301-501 邮编: 518129 (86-755) 25328673 sgs.china@sgs.com



TEST REPORT

No. : SZIN2311002595PL05_EN

Date : 2023-12-08

Page: 4 of 12

IV. Test results

Throughout the test on each specimen, carefully observe the material's behaviour within the apparatus and take special note of any of the following phenomena listed in clause 9.2 of the standard. None of the listed phenomena was observed and the test results on all three specimens tested were valid.

The index of the performance for the specimen was determined as follows:

$$S_1 = \sum_{t=0.5}^{t=3} \frac{\theta_s - \theta_c}{10t}, S_2 = \sum_{t=4}^{t=10} \frac{\theta_s - \theta_c}{10t}, S_3 = \sum_{t=12}^{t=20} \frac{\theta_s - \theta_c}{10t}, S = S_1 + S_2 + S_3$$

Where:

S = index of performance for each of the specimens tested and S1, S2 and S3 are sub-indices

t = Time in minutes from the origin at which readings are taken

θ_s = Temperature rise in °C for the specimen at time, t

θ_c = Temperature rise for the calibration sheet at time, t

This assessment/test report is not valid unless endorsed by China Union Building Materials Ltd.

Fire Propagation index $I = i_1 + i_2 + i_3$

Where, i_1 , i_2 and i_3 are given by the expressions:

$$i_1 = \frac{1}{3} [(S_1)_A + (S_1)_B + (S_1)_C], i_2 = \frac{1}{3} [(S_2)_A + (S_2)_B + (S_2)_C], i_3 = \frac{1}{3} [(S_3)_A + (S_3)_B + (S_3)_C]$$

The following test results were obtained for each specimen tested:

Specimen No.	Sub - indices			Index of performance
	S ₁	S ₂	S ₃	S
A	0.0	0.0	0.0	0.0
B	0.0	0.0	0.0	0.0
C	0.0	0.0	0.0	0.0



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing/inspection report & certificate, please contact us at telephone: (+86-755) 8307 1443, or email: CN.Openscheck@sgs.com

SGS (China) Inspection & Testing Services Co., Ltd.
Shenzhen Branch Testing Services Materials Laboratory

Room 10F-901, Plant 4&8 Floor 10F, Plant 2&8 Floor 10F, Plant 3&8 Floor 301-501 Plant 1, Jieqiao Road, Bantian Community, Bantian Street, Luogang District, Shenzhen, Guangdong, China 51129 www.sgs.com.cn
中国·广东·深圳市龙岗区坂田街道社区在华南城10号江源(坂田)工业厂区4号101-101, 2号101, 3号101, 3号301-501 邮编 518129 (86-755) 23328673 sgs.china@sgs.com

TEST REPORT

No. : SZIN2311002595PL05_EN

Date : 2023-12-08

Page: 5 of 12

Number of Specimens tested	Sub-index i ₁	Sub-index i ₂	Sub-index i ₃	Fire Propagation index I
3	0.0	0.0	0.0	0.0

Test 2:

I. Test conducted

This test was performed in accordance with the procedure specified in BS 476 Part 7:1997+CORR:2014 Fire tests on building materials and structures Part 7. Method of test to determine the classification of the surface spread of flame of products.

II. Sample details

Sample description★	GNG Standard Gypsum Board
Thickness	12mm
Color	Grey
Specimen size	885mm x 270mm

The above data and information with ★ was / were submitted and identified on behalf of the client. SGS is not responsible for the authenticity, integrity and results of the data and information and / or the validity of the conclusion. results apply to the sample as received.

III. Test details

Conditioning of specimens:	Prior to testing, the sample was conditioned to constant mass at a temperature of (23 ± 2) °C, and a relative humidity of (50 ± 10)%, and maintained in this condition until required for testing.
Exposed Face:	Marked surface
Form in which the specimens to be tested	Composite
Mounting of specimens	Unexposed face of the specimen placed directly on, and in direct contact with, a backing board without any adhesion or mechanical fixing.

Irradiance along horizontal reference line on the calibration board



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS (Shenzhen) Technical Services Co., Ltd.
Shenzhen Branch Inspection & Testing Materials Laboratory

Room 101-011, Plant A & Room 101, Plant B & Room 101, Plant C, Jieqiao (Bantian) Industrial Plant Area, No. 430, Jieqiao Road, Bantian Community, Bantian Street, Luogang District, Shenzhen, Guangdong, China 518129 www.sgs.com
中国·广东·深圳龙岗区坂田街道坂田社区吉华路430号江源(坂田)工业厂区厂房4号101-101, 2号101, 3号101, 3号301-501 邮编: 518129 (86-755) 23328673 sgs.china@sgs.com

TEST REPORT

No. : SZIN2311002595PL05_EN

Date : 2023-12-08

Page: 6 of 12

Distance along reference line from inside edge of specimen holder	Irradiance / (kW/m ²)		
	mm	Specified	Min.
75	32.5	32.0	33.0
225	21.0	20.5	21.5
375	14.5	14.0	15.0
525	10.0	9.5	10.5
675	7.0	6.5	7.5
825	5.0	4.5	5.5

This assessment/test report is not valid unless endorsed by China Union Building Materials Ltd.



SGS Construction Services (Shenzhen) Co., Ltd.
Shenzhen Branch Inspection & Testing Services Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing/inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

Room 101-1011, Plant 4 & Room 1011, Plant 2 & Room 1011, Plant 3 & Room 301-501, Plant 1, Jianghu Industrial Park Area, No. 430, Jhuo Road, Bantian Community, Bantian Street, Luogang District, Shenzhen, Guangdong, China 518129 www.sgs.com
 中国·广东·深圳市龙岗区坂田街道坂田社区吉华路430号江湖(坂田)工业厂区厂房4号101-1011, 2号101, 3号101, 5号301-501 邮编: 518129 (86-755) 25328673 sgs.china@sgs.com

TEST REPORT

No. : SZIN2311002595PL05_EN

Date : 2023-12-08

Page: 7 of 12

IV. Test results

Specimen No.	1	2	3	4	5	6
Distance (mm)	Time to travel to indicated distance (minutes:seconds)					
75	--	--	--	--	--	--
165	--	--	--	--	--	--
190	--	--	--	--	--	--
215	--	--	--	--	--	--
240	--	--	--	--	--	--
265	--	--	--	--	--	--
290	--	--	--	--	--	--
375	--	--	--	--	--	--
455	--	--	--	--	--	--
500	--	--	--	--	--	--
525	--	--	--	--	--	--
600	--	--	--	--	--	--
675	--	--	--	--	--	--
740	--	--	--	--	--	--
750	--	--	--	--	--	--
785	--	--	--	--	--	--
825	--	--	--	--	--	--
Maximum distance traveled at 1.5 minutes (mm)	<75	<75	<75	<75	<75	<75
Maximum distance traveled during the whole test (mm)	<75	<75	<75	<75	<75	<75
Time to reach maximum distance traveled	10min	10min	10min	10min	10min	10min
Observations during test	charring	charring	charring	charring	charring	charring

This assessment/test report is not valid unless endorsed by
 China Union-Building Materials-Ltd.



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing/inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

Room 101-301, Plant 4 & Room 101, Plant 2 & Room 101, Plant 3 & Room 301-501 Plant 1, Jiahua Road, Bantian Community, Bantian Street, Luogang District, Shenzhen, Guangdong, China 518129 www.sgs.com
 中国·广东·深圳市龙岗区坂田街道坂田社区吉华路401号江源(坂田)工业区厂房4号101-101, 2号101, 3号101, 5号301-501 邮编: 518129 t:(86-755) 25328673 sgs.china@sgs.com

TEST REPORT

No. : SZIN2311002595PL05_EN

Date : 2023-12-08

Page: 8 of 12

Note: 1. "--" Not reached the reference line

2. Six specimens are usually tested. If the test on any specimen is deemed to be invalid, as defined in the standard, it is permissible for up to a maximum of nine specimens to be tested in order to obtain the six valid test results.

The classification limits specified in BS 476-7:1997+CORR:2014 are given in Appendix 1.

Criteria for classification:

If the prefix "D" or suffix "R" or "Y" is included in the classification, this indicates that the results should be treated with caution. An explanation of the reason for prefix and suffixes is given in Appendix 2

Appendix 1 Classification of spread of flame

Classification	Spread of flame at 1.5 min		Final spread of flame	
	Limit (mm)	Limit for one specimen in	Limit (mm)	Limit for one specimen in sample(mm)
Class 1	165	165+25	165	165+25
Class 2	215	215+25	455	455+45
Class 3	265	265+25	710	710+75
Class 4	Exceeding the limits for class 3			

Appendix 2 Explanation of prefix and suffixes which may be added to the classification

1. A suffix R is added to the classification if more than six specimens are required in order to obtain six valid test results (e.g. class 2R).
2. A prefix D is added to the classification of any product which does not conform to the surface characteristics specified in the standard and has therefore been tested in a modified form (e.g. class D3).
3. A suffix Y shall be added to the classification if any softening and/or other behaviour that may affect the flame spread occurs.



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS CSTI (China) Technical Services Co., Ltd.
Shenzhen Branch Test & Calibration Laboratory

Room 101-1011, Plant 4 & Room 111, Plant 2 & Room 111, Plant 3 & Room 301-3011 Plant 1, Jiangshan (Bantian) Industrial Plant, No. 430, Jhuas Road, Bantian Community, Bantian Street, Luogang District, Shenzhen, Guangdong, China 511123 www.sgs.com
中国·广东·深圳市龙岗区坂田街道坂田社区吉华路430号江灏(坂田)工业区厂房4号101-1011, 2号101, 3号101, 5号301-501 邮编: 518129 (86-755) 25328673 sgs.china@sgs.com

TEST REPORT

No. : SZIN2311002595PL05_EN

Date : 2023-12-08

Page: 9 of 12

Classification: In accordance with the class definitions given in BS 476 Part 7:1997+CORR:2014, the tested sample is classified as **Class 1**.

Requirement of UK Building Regulations 2010 Approved Document B (2006 edition) ,

Volume 1-Dwellinghouse appendix A paragraph 13:

A Class 0 is the highest national product performance classification for lining materials, and the requirements laid down in the UK Building Regulation 2010 Approved Document B(2006 edition), Volume 1-Dwellinghouse, appendix A paragraph 13. This is achieved if a material or the surface of a composite product is either:

- a. composed throughout of materials of a limited combustibility; or
- b. a Class 1 materials which has a fire propagation index (I_f) of not more than 12 and sub-index (i₁) of not more than 6.

Statements:

This declaration of conformity is only based on the result of this laboratory activity, the impact of the uncertainty of the results was not included.

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test. They are not intended to be the sole criterion for assessing the potential fire hazard of the product in use.

The test results relate only to the specimens of the product in the form in which were tested. Small differences in the composition or thickness of the product may significantly affect the performance during the test and may therefore invalidate the test results. Care should be taken to ensure that any product, which is supplied or used, is fully represented by the specimens, which were tested.

This assessment/test report is not valid unless endorsed by China Union Building Materials Ltd.



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.
Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com
Room 101-301, Plant 4 & 5 Floor 11', Plant 2 & 3 Floor 11', Plant 3 & 4 Floor 31-501 Plant 1, Jiaoghai (Bantian) Industrial Plant/Area, No. 431, Jihai Road, Bantian Community, Bantian Street, Luogang District, Shenzhen, Guangdong, China 518123 www.sgs.com.cn
中国·广东·深圳市龙岗区坂田街道雪社区官华路431号江源(坂田)工业厂区4号101-101, 2号101, 3号101, 5号301-501 邮编: 518121 (86-755) 25328673 sgs.china@sgs.com


TEST REPORT

No. : SZIN2311002595PL05_EN

Date : 2023-12-08

Page: 10 of 12

Photo Appendix:

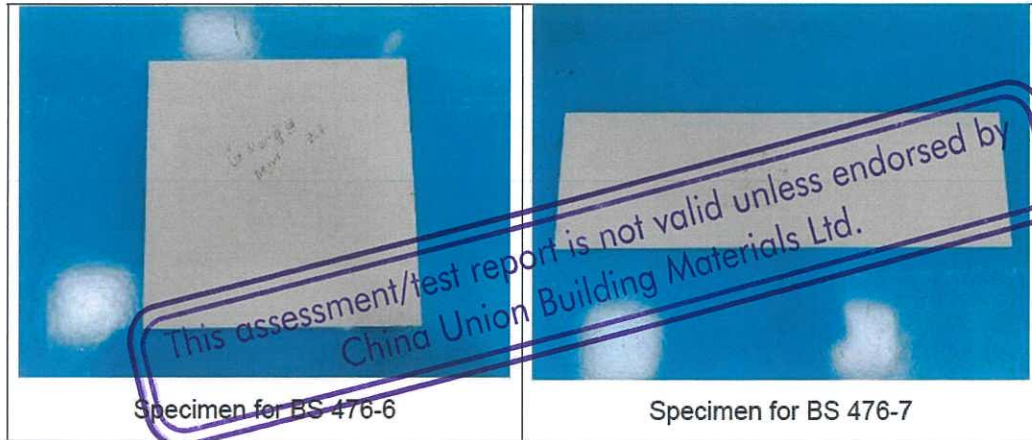

SGS-CSTC (China) Testing Co., Ltd.
Shenzhen Branch Testing Materials Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing/inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Docscheck@sgs.com

Room 104-301, Plant 4 & Room 111, Plant 2 & Room 111, Plant 3 & Room 311-501 Plant 1, Jiahua Road, Bantian Community, Bantian Street, Luogang District, Shenzhen, Guangdong, China 518129 www.sgs-group.com.cn
中国·广东·深圳市龙岗区坂田街道坂田社区在华南43号江鹏(坂田)工业区厂路4号101-101, 2号101, 3号101, 5号301-501 邮编: 518129 (86-755) 25326673 sgs.china@sgs.com

TEST REPORT

No. : SZIN2311002595PL05_EN

Date : 2023-12-08

Page: 11 of 12

Test 3

TESTS AND RESULTS

Test Conducted:

This test is conducted in accordance with BS 476-4:1970+CORR:2014 Fire tests on building materials and structures-Part 4: Non-combustibility test for materials.

Conditioning of specimen:

Preconditioning: Temperature: (60±5)°C; Duration: 24h

Designation of non-combustibility:

The material shall be deemed non-combustible if, during the test, none of the three specimens either

- 1) causes the temperature reading from either of the two thermocouples to rise by 50 C or more above the initial furnace temperature, or
- 2) is observed to flame continuously for 10 s or more inside the furnace.

Otherwise, the material shall be deemed combustible.

Test Results:

Specimen	ΔT_f (°C)	ΔT_c (°C)	Flame continuance (s)
1	10.9	-29.6	0
2	10.1	-23.0	0
3	11.7	-29.7	0

Remark: ΔT_f -Temperature rise of the furnace thermocouples above the initial furnace temperature;

ΔT_c -Temperature rise of the sample centre thermocouples above the initial furnace temperature;

Conclusion:

According to the test result, the submitted material shall be deemed non-combustible.



SGS CSTO (China) Technical Services Co., Ltd.
Shenzhen Branch Inspection & Testing Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing/inspection report & certificate, please contact us at telephone: (86-755) 8337 1443, or email: CN.Doccheck@sgs.com.
Room 101-101; Plant 4 & Room 101; Plant 2 & Room 101; Plant 3 & Room 301-501; Plant 1, Jiangnan (Bantian) Industrial Plant Area, No. 430, Jihua Road, Bantian Community, Bantian Street, Longgang District, Shenzhen, Guangdong, China 511729 www.sgs.com
中国·广东·深圳市龙岗区坂田街道坂田社区吉华路430号江楠(坂田)工业区厂区4号101-101, 2号101, 3号101, 5号301-501 邮编: 518129 (86-755) 25328673 sgs.china@sgs.com

TEST REPORT

No. : SZIN2311002595PL05_EN

Date : 2023-12-08

Page: 12 of 12

SAMPLE INFORMATION AND PICTURES

Density: 650kg/m³

Actual size of Specimen: 40mm×40mm×10mm



Appendix information:

The above test methods were carried out by SGS CSTC Standards Technical Services Co., Ltd. Shunde Branch

This assessment/test report is not valid unless endorsed by China Union Building Materials Ltd.

*****End of report*****



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing/inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

Room 101-301, Plant 4&5 Floor 11', Plant 2&3 Floor 11', Plant 3&6 Floor 301-301' Plant 1, Jiangshou (Bantian) Industrial Plant Area, No. 430, Jihua Road, Bantian Community, Bantian Street, Luogang District, Shenzhen, Guangdong, China 51129 www.sgs.com.cn
中国·广东·深圳市龙岗区坂田街道坂田社区吉华路430号五洲(坂田)工业区厂路4号101-101, 2号101, 3号101, 5号301-501 邮编: 518129 (86-755) 25328673 sgs.china@sgs.com